

Performance Analysis of Surface Condenser under Various Operating Parameters

1. B.PRASADA RAO, 2. Mr.G.VEERENDRA NAIK

¹PG SCHOLAR, DEPARTMENT OF MECHANICAL ENGINEERING, GANDHI ACADEMY OF TECHNICAL EDUCATION-KODAD

² ASSISTANT PROFESSOR, DEPARTMENT OF MECHANICAL ENGINEERING, GANDHI ACADEMY OF TECHNICAL EDUCATION-KODAD

ABSTRACT:

The thermal power plants are used to generate power. The thermal power plants are designed based on required conditions (like a good quality of steam, pressure and temperature of steam etc.), but actually inlet conditions are not as per the designed conditions. In practical situations, when power plants are installed there are lots of constraints. This tends to reduce or increase output power and heat rate of thermal power plants. Due to these conditions, the designed power and heat rate are never achieved. Variations in the power outputs from plant are always a matter of disputes. So the parameters for power and heat rate are generated for different conditions of condenser pressure, flow rate of water through the condenser, Temperature difference. On the basis of site measurement and design data collection performance of the Condenser unit can be evaluated. These evaluations indicate that if operating conditions vary, then power output and heat rate also vary. This paper deals with the factors or parameters which reduced the efficiency of the condenser.

1.INTRODUCTION

The condenser is a heat transfer device or unit used to condense a substance from its gaseous to its liquid state, typically by cooling it. In doing so, the latent heat is given up by the substance, and will transfer to the condenser coolant. Use of cooling water or surrounding air as the coolant is common in many condensers. The main use of a condenser is to receive exhausted steam from a steam engine or turbine and condense the steam. The benefit being that the energy which would be exhausted to the atmosphere is utilized .A steam condenser generally condenses the steam to a pressure

significantly below atmospheric. This allows the turbine or engine to do more work. The condenser also converts the discharge steam back to feed water which is returned to the steam generator or boiler. In the condenser the latent heat of condensation is conducted to the cooling medium flowing through the cooling tubes. [1] In practical situations, when power plants are installed there are lots of constraints. This tends to reduce or increase output power and heat rate of thermal power plants. Due to these conditions, the designed power and heat rate are never achieved. [2- 5] The percentage ratio of the exergy destruction to the total

exergy destruction was found to be maximum in the boiler system 86.27% and then condenser and stack gas 13.73%. In addition, the calculated thermal efficiency was 38.39 % while the exergy efficiency of the power cycle was 45.85%. [6]

II. DESCRIPTION Basically, a condenser is a device where steam condenses and latent heat of evaporation released by the steam is absorbed by cooling water. Thermodynamically, it serves the following purposes with reference to the P-v diagram shown in Figure 1. Firstly, it maintains a very low back pressure on the exhaust side of the turbine. As a result, the steam expands to a greater extent and consequently results in an increase in available heat energy. The shaded area shown in the P-v diagram exhibits the increase in the work obtained by fitting a condenser unit to a non-condensing unit for the same available steam properties. In the P-v diagram,

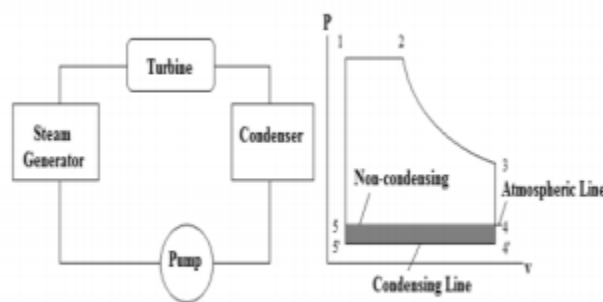


Figure 1: Key components of a thermal power plant working on a Rankine Cycle [7]

line 4-5 is non-condensing line when the condenser unit is not applied and line 4''-5'' is a condensing line when the condenser is used. Secondly, the exhaust steam condensate is free from impurities. Thermal efficiency of a condensing unit is higher than that of a non-condensing unit for the same available steam properties. In a reciprocating steam engine, the condenser pressure can be reduced to about 12 to 15 cm. of Hg. The thermodynamic analysis of condensate application is discussed in a thermal power plant using regenerative Rankine cycle with a closed feed water heater and pumped condensate as shown in the configuration of Figure 2. Condensate is pumped from the condenser through the Feed Water Heater (FWH) directly to the steam generator and to the turbine along the path 4-5-8-9-1. Ideally, $P_5 = P_1$ assuming no pressure drop occurs in the feed water heater and steam generator. As the operating pressure of the condenser is low due to an increased vacuum, the enthalpy drop of the expanding steam in the turbine will increase. This increases the amount of available work from the turbine. The low condenser operating pressure enables higher turbine output, an increase in plant efficiency and reduced steam flow for a given plant output. It is, therefore, advantageous to operate the condenser at the lowest possible pressure

(highest vacuum).[10-12] The condenser provides a closed space into which the steam enters from the turbine and is forced to give up its latent heat of vaporization to the cooling water. It becomes a necessary component of the steam cycle as it converts the used steam into water for boiler feed water and reduces the operational cost of the plant. Also, efficiency of the cycle increases as it operates with the largest possible delta-T and delta-P between the source (boiler) and the heat sink (condenser). As the steam condenses, the saturated liquid continues to transfer heat to the cooling water as it falls to the bottom of the condenser, or hot-well. This is called sub-cooling, which is desirable up to a certain extent. The difference between the saturation temperature for the existing condenser vacuum and the temperature of the condensate is termed condensate depression. [13, 14] This is expressed as a number of degrees condensate depression or degrees sub-cooled. However, the pump is designed according to the available net-positive-suction-head (NPSH) which is given as: $NPSH = \text{Static head} + \text{surface pressure head} - \text{the vapour pressure of product} - \text{the friction losses in the piping, valves and fittings}$. There are two primary types of condensers that can be used in a power plant: 1. direct contact or jet condenser 2.

surface condenser 3. Direct Dry Air cooled Condenser. Direct contact condensers condense the turbine exhaust steam by mixing it directly with cooling water. The older type Barometric and JetType condensers operate on similar principles. The direct dry Air-cooled Condenser is beyond the scope of this paper.

2.1 ELEMENTS OF SURFACE CONDENSER

The basic components of a surface condenser are. The heat transfer mechanism is the condensation of saturated steam outside the tubes and the heating of the circulating water inside the tubes. Thus, for a given circulating water flow rate, the water inlet temperature to the condenser determines the operating pressure of the condenser. As this temperature is decreased, the condenser pressure will also decrease. As described above, this decrease in the pressure will increase the plant output and efficiency. Steam condensation enables a vacuum and non-condensable gases will migrate towards the condenser. The noncondensable gases consist of mostly air that has leaked into the cycle from components that are operating below atmospheric pressure. These gases are also formed by the decomposition of water into oxygen and hydrogen. These gases must be vented from the condenser for the following reasons: (a) The gases will increase the

operating pressure of the condenser. This rise in pressure will decrease the turbine output and efficiency. (b) The gases will blanket the outer surface of the tubes. This will severely decrease the heat transfer rates of the steam to the circulating water, and pressure in the condenser will increase. (c) The corrosiveness of the condensate in the condenser increases as the oxygen content increases. Thus, these gases must be removed in order to enhance the life of components.

2.2 AIR REMOVAL The two main devices that are used to vent the no condensable gases are Steam Jet Air Ejectors and Liquid Ring Vacuum Pumps. Steam Jet Air Ejectors (SJAE) use high-pressure motive steam to evacuate the non-condensable from the condenser (Jet Pump). Liquid Ring Vacuum Pumps use liquid to compress the evacuated non-condensable gases and then these are discharged into the atmosphere. Condensers are equipped with an Air-Cooler section for the removal of non-condensable gases. The AirCooler section of the condenser consists of a number of tubes that are baffled to collect the no condensable. Cooling of the non-condensable gases reduces the volume and size of the air removal equipment. Air removal equipment must operate in two modes: hogging and holding. Prior to admitting exhaust steam to

a condenser, all the noncondensable gases must be removed. In hogging mode, large volumes of air are quickly removed from the condenser in order to reduce the condenser pressure from atmospheric to a predetermined level. Once the desired pressure is achieved, the air removal system can be operated in the holding mode to remove all non-condensable gases

III. PERFORMANCE ANALYSIS OF CONDENSER Performance Evaluation of Amarkantak Thermal Power Station by Performance Analysis of Steam Turbine Cycle,

3.1 COMPARISON OF DESIGN AND OPERATING PARAMETER OF CONDENSER Insulation and steam drain systems based on present operating condition of plant and then compare it with design performance. The generating consists of two condenser units, each having same specification. The flow rate of water through the condenser, Temperature difference and pressure were measured. On the basis of site measurement and design data collection performance of the Condenser unit 1 can be evaluated.

CONCLUSION From all the analysis of ATPS, this paper realized that the power plant has proposed on 120MW but they could get worked on 75.24 MW. This paper

evaluated all the aspects of condenser which affecting the performance of power plant. This paper worked on three causes which affecting the performance of condenser are deviation due to inlet temperature of cold water is 25.4mbar, deviation due to cold water flow and load 0.8mbar, deviation due to air ingress/dirty tube, so total deviation of pressure in the condenser is 35.4mbar. Eventually, this paper find that the total efficiency of a power plant will reduces to 0.4% by all these deviation in the condenser and by overcome these three reasons, the performance of power plant can be rises with a good level.

REFERENCES

[1] M. Baweja, V.N. Bartaria, “A Review on Performance Analysis of Air-Cooled Condenser under Various Atmospheric Conditions,” International Journal of Modern Engineering Research (IJMER), Vol.3, Issue.1, pp 411-414, Jan-Feb. 2013.

[2] A. Geete and A. I. Khandwawala, “Exergy Analysis of 120MW Thermal Power Plant with Different Condenser Back Pressure and Generate Correction Curves,” International Journal of Current Engineering and Technology, Vol.3, No.1 , pp 164-167, March 2013.

[3] V. S. K. Karri, “A Theoretical Investigation of Efficiency Enhancement in Thermal Power Plant,” Modern Mechanical Engineering, Vol.2 No.3, 106-113, Aug. 2012.

[4] A.K. Jain, “An Optimal Preventive Maintenance Strategy for Efficient Operation of Boilers in Industry,” International Institute for Science, Technology and Education, Vol. 2, No. 4, 2012. [5] H. Gao, C. Liu, C. He, X. Xu, S. Wu and Y. Li, “Performance Analysis and Working Fluid Selection of a Supercritical Organic Rankine Cycle for Low Grade Waste Heat Recovery,” Energies, 5, 3233-3247, 2012

[6] A. Vosough, A. Falahat, S. vosough, H. Nasresfehani, A. Behjat and R. Naserirad, “Improvement Power Plant Efficiency with Condenser Pressure”, International Journal of Multidisciplinary Sciences and Engineering, Vol.2, No. 3, 38-43, June 2011.

[7] R. K. Kapooria, K.S. Kasana and S. Kumar, “Technological investigations and efficiency analysis of a steam heat exchange condenser: conceptual design of a hybrid steam condenser”, Journal of Energy in Southern Africa, Vol 19 No 3, 35- 45, Aug.2008.

[8] L. M. Romeo, I. Bolea, J. M. Escosa, "Integration of power plant and amine scrubbing to reduce CO₂ capture costs," Applied Thermal Engineering, Vol. 28, Issue 8-9, PP. 1039-1046, 2007.

[9] J. Tarlecki, N. Lior, N. Zhang, "Evaluation of Some Thermal Power Cycles for Use in Space," Department of Mechanical Engg. And Applied Mechanics, Proc. ECOS. Crete, Greece. 12-14 July 2006.

[10] Upgrading, Renovation & Modernization Of Ageing Thermal Power Plant, Report By N.K. Srivastava, Gen. Manager, and R&M Engg. NTPC-INDIA, 2010.

[11] Thermal Power Plant Performance Improvement Using Quality Initiatives, NTPC Report by S. Banerjee, S.N. Tripathi, Mohit Yadav, 2008.

[12] Renovation and Modernization of Thermal Power Plants in India planning and implementation guidelines, June 2010.

[13] Opportunities to Improve the Efficiency of Existing Coal-fired Power Plants, Workshop Report, July 15-16, 2009.

[14] National awards on energy conservation for industries, office & bpo buildings, hotels & hospitals, municipalities, state designated agencies, thermal power

stations, zonal railways, and manufacturers of bee star labelled appliances/equipment – 2011.